

MAINTENANCE RANGE

Page 1/2

Revision-Date


A- 06/2013

T 1

SOFTENER TYPE : **BWT 6000 ALCYO**

Greyed items : Service may be included in BWT France maintenance contracts.

Greyed items: Service may be included in BWP. Please maintenance contracts.													
Item.	Action	Frequency										Comments	Item numbers for spare or wear parts
		Daily	Weekly	Monthly	Quarterly	Every 6 months	Yearly	Every 2 years	Every 3 years	Every 4 years			
1	Salt refill	x										Depending on soft water consumption	
2	Hardness analysis of feeding water			x								The frequency may be shortened depending on the criticality of the equipment behind the softener.	Analysis set, article number P0001561A
3	Hardness analysis behind the softener			x								The frequency may be shortened depending on the criticality of the equipment behind the softener.	Analysis set, article number P0001561A
4	Chlorine analysis of feeding water (after regeneration)			x								The frequency may be shortened depending on the criticality of the equipment behind the softener.	Analysis set, article number P0029860 (2 to 60 ppm) or strips P0005030 (30 to 600 ppm)
5	Chlorine analysis after the softener (after regeneration)			x								The frequency may be shortened depending on the criticality of the equipment behind the softener.	Analysis set, article number P0029860 (2 to 60 ppm) or strips P0005030 (30 to 600 ppm)
6	Regeneration test				x								
7	Check of internal parts of the valve and cleaning					x							
8	Tightness check					x							
9	Programming check					x							
10	Use of AQACLEAN CT					x	x					The frequency may be shortened depending on the feed water quality.	Depending on softener type
11	Cleaning of brine tank						x					The frequency may be shortened depending on the used salt and the water consumption.	
12	Replacement of reed switch in turbine						x						P0012620 (10)
13	Replacement of brine suction tubing							x					P0014892 (per meter)
14	Replacement of piston							x				The frequency may be shortened depending on the pressure, the water quality and the number of regenerations.	P0012460 (6)
15	Replacement of solenoid valves							x				The frequency may be shortened depending on the pressure, the water quality and the number of regenerations.	P0012711 (4) P0012710 (5)
16	Replacement of brine valve								x			The frequency may be shortened depending on the pressure, the water quality and the number of regenerations.	P0014854 (A)
17	Replacement of inlet/ outlet flexible hoses									x			PK0001107

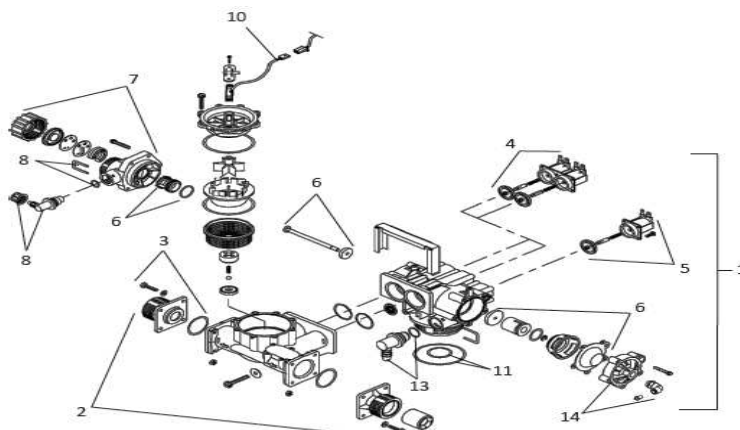

BWT PERMO

103 Rue Charles Michels

93206 Saint Denis Cedex France

Téléphone : 01 49 22 46 46

Fax : 01 49 22 46 07