
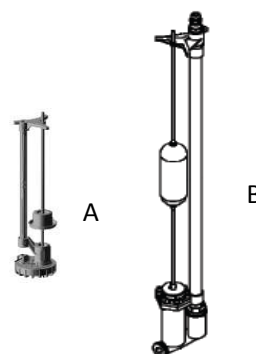


SOFTENER TYPE : BWT 7000 ALCYO

Greyed items : Service may be included in BWT France maintenance contracts.

Item.	Action	Frequency										Comments	Item numbers for spare or wear parts
		Daily	Weekly	Monthly	Quarterly	Every 6 months	Yearly	Every 2 years	Every 3 years	Every 5 years			
1	Salt refill	x									Depending on soft water consumption		
2	Hardness analysis of feeding water			x							The frequency may be shortened depending on the criticality of the equipment behind the softener.	Analysis set, article number P0001561A	
3	Hardness analysis behind the softener			x							The frequency may be shortened depending on the criticality of the equipment behind the softener.	Analysis set, article number P0001561A	
4	Chlorine analysis of feeding water (after regeneration)			x							The frequency may be shortened depending on the criticality of the equipment behind the softener.	Analysis set, article number P0029860 (2 to 60 ppm) or strips P0005030 (30 to 600 ppm)	
5	Chlorine analysis after the softener (after regeneration)			x							The frequency may be shortened depending on the criticality of the equipment behind the softener.	Analysis set, article number P0029860 (2 to 60 ppm) or strips P0005030 (30 to 600 ppm)	
6	Regeneration test				x								
7	Tightness check				x								
8	Check of internal parts of the valve and cleaning					x							
9	Programming check					x							
10	Use of AQACLEAN CT					x	x				The frequency may be shortened depending on the feed water quality.	Depending on softener type	
11	Cleaning of brine tank						x				The frequency may be shortened depending on the used salt quality and the water consumption.		
12	Replacement of brine suction tubing							x				Depending on softener type P0014892 6x8 (per meter) or P0090365 11x14 (per meter)	
13	Replacement of piston							x			The frequency may be shortened depending on the pressure, the water quality and the number of regenerations.	P0013558 (6)	
14	Replacement of solenoid valves							x			The frequency may be shortened depending on the pressure, the water quality and the number of regenerations.	P0010132 (4)	
15	Replacement of inlet/outlet pilotes								x		The frequency may be shortened depending on the pressure, the water quality and the number of regenerations.	2 x P0001704 (5)	
16	Replacement of brine valve								x		The frequency may be shortened depending on the pressure, the water quality and the number of regenerations.	P0014854 (A) or P0014822 depending on softener model	
17	Chlorine cell and cable (optional)									x		Depending on softener type	
18	Replacement of inlet/ outlet flexible hoses									x		P0001107	

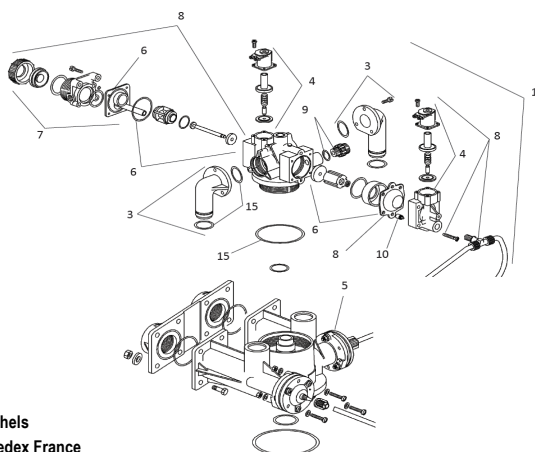

BWT PERMO

103 Rue Charles Michels

93206 Saint Denis Cedex France

Téléphone : 01 49 22 46 46

Fax : 01 49 22 46 07